

Figure 1


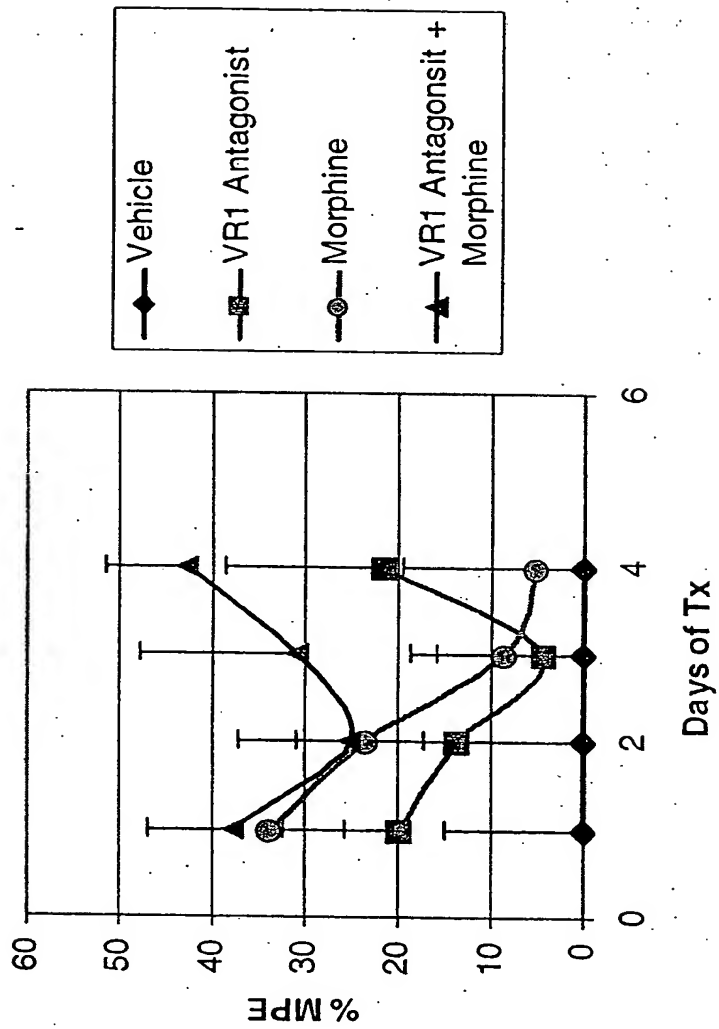


Figure 2

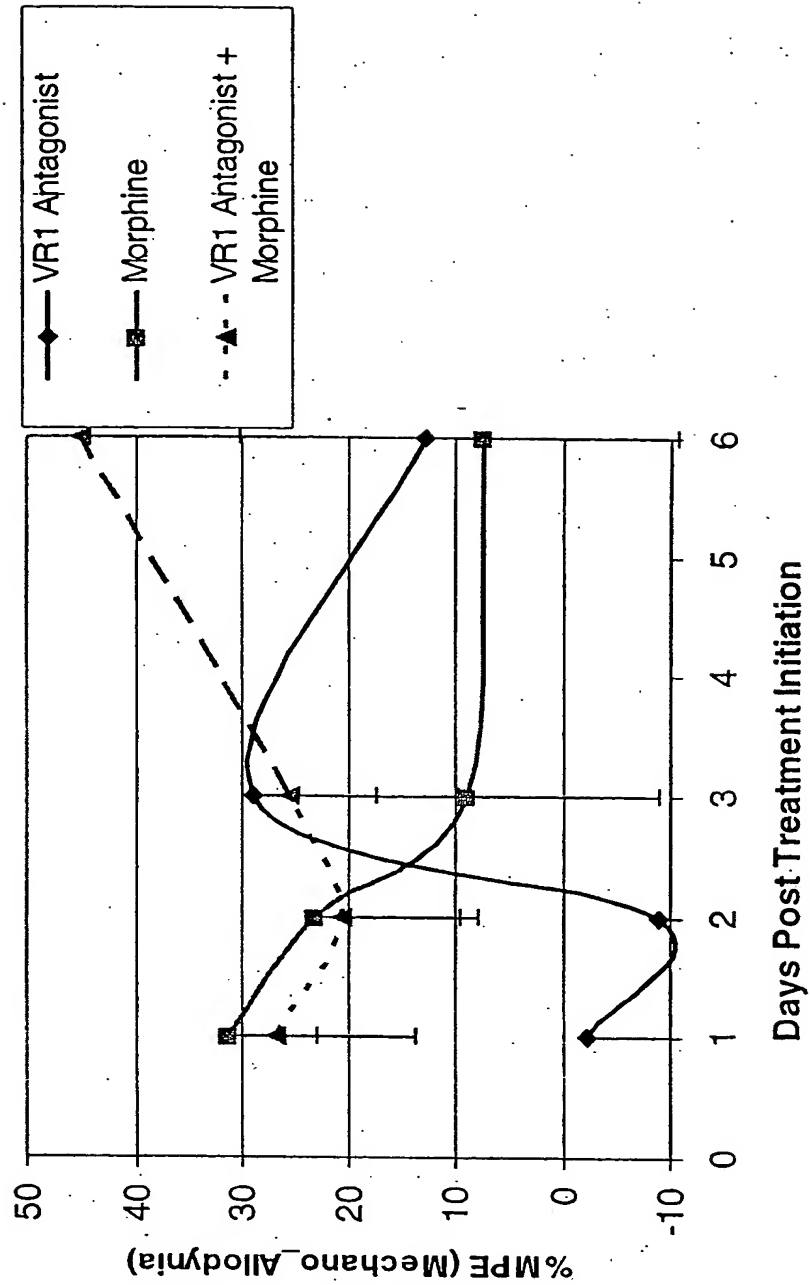

# Mechanical paw withdrawal threshold

Ipsilateral paw only

\*= p<0.05 vs MC / saline group

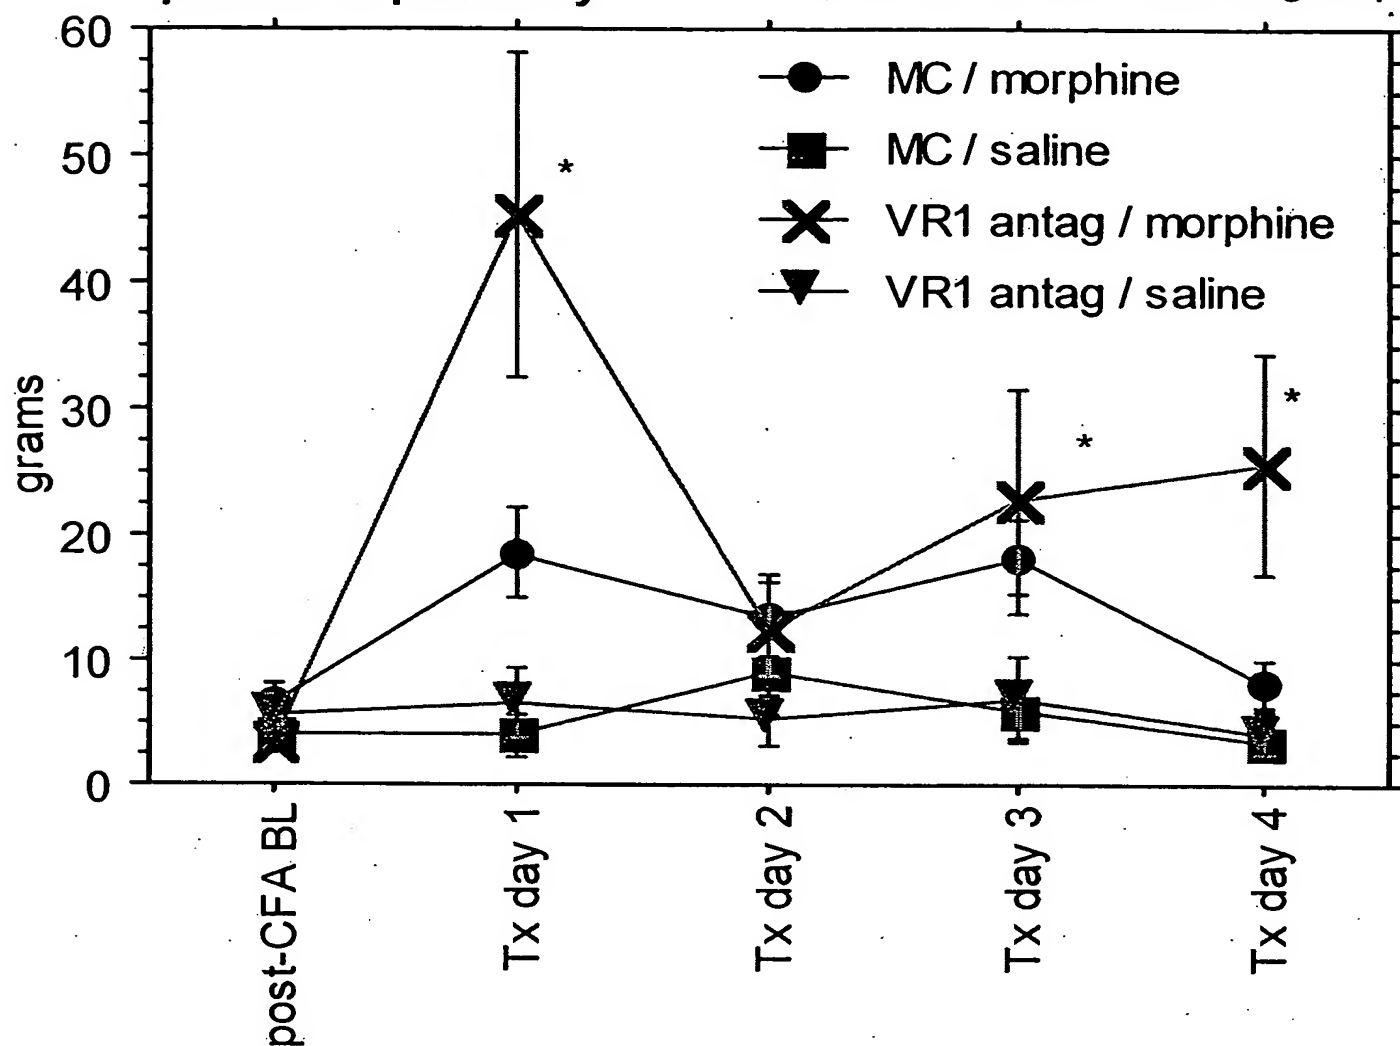


Figure 3

BEST AVAILABLE COPY

# Thermal paw withdrawal latency

Test score - baseline score

\*= p<0.05 vs vit E / saline group

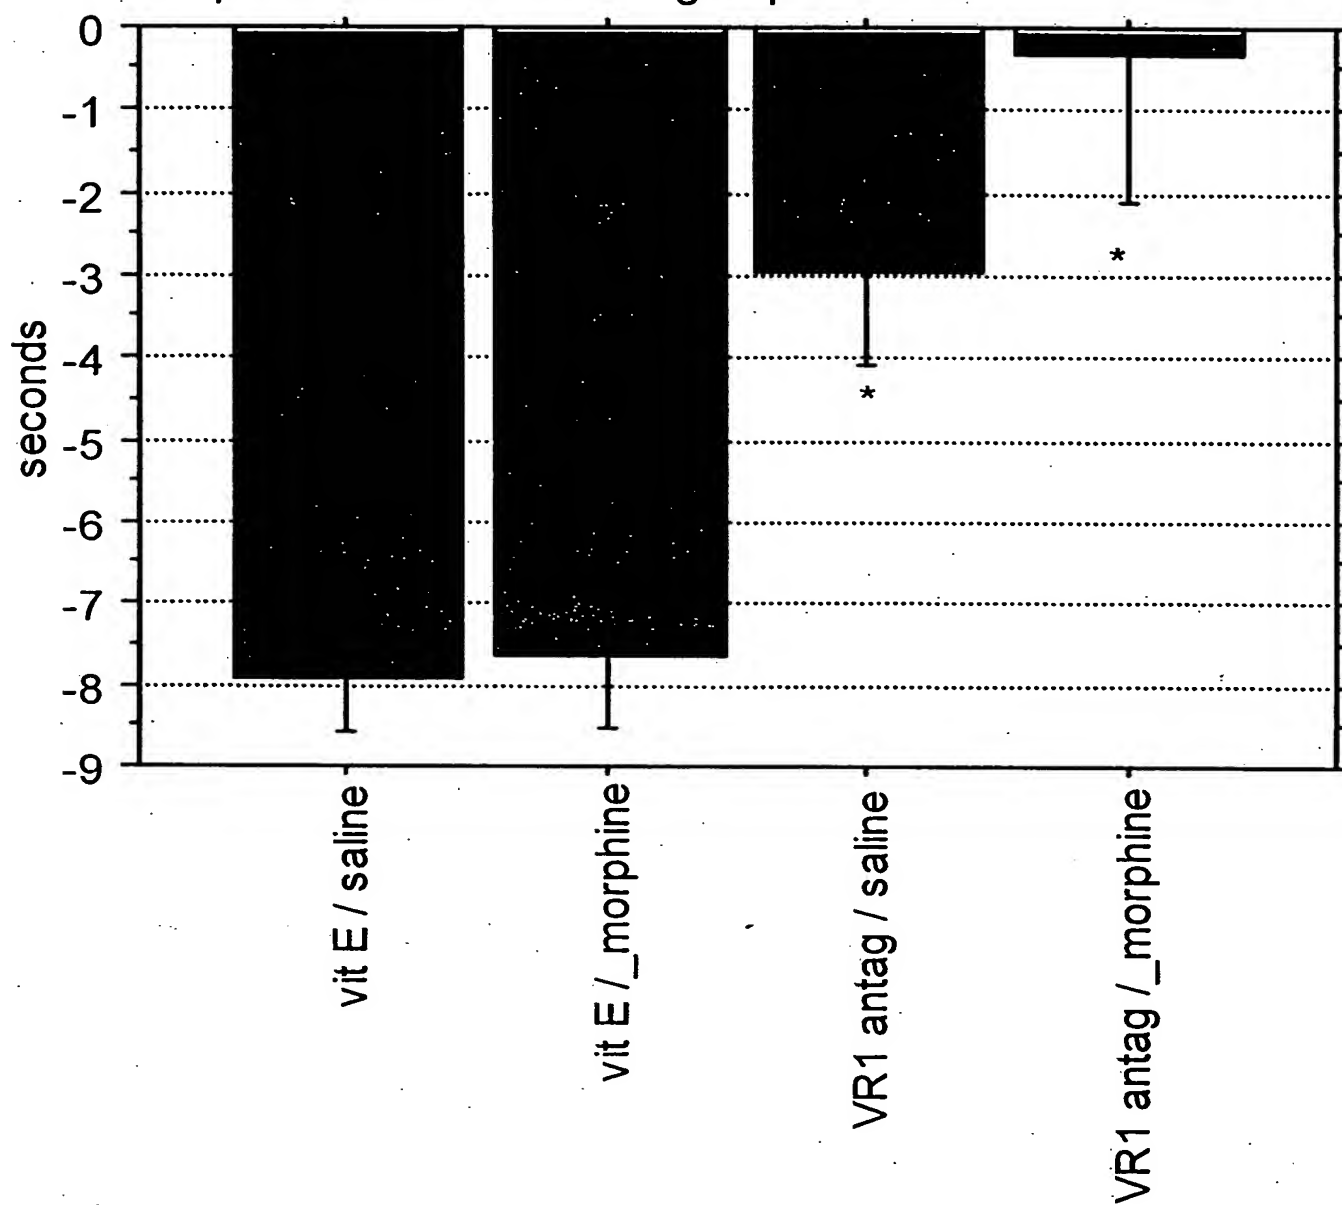


Figure 4

BEST AVAILABLE COPY